

*Results of Tests on Brick conducted in accordance with ASTM C67-12 Standard Method for Sampling and*

*Testing Brick and Structural Clay Tile*

04/19/2013

Name:	Glen-Gery Corporation 433 S. Pottsville Pike Shoemakersville, PA 19555	Plant:	Mid-Atlantic
Phone:	610-562-3076	Report Number:	GGMA-0788
Fax:	610-562-2084	Sampled Date:	02/17/2012
		Lot:	
		Product Code:	72502200

Sample Description: **Mid-Atlantic Shale Molded Thin Brick**


	1	2	3	4	5	Average	Test Date
<b>Absorption</b>							
24 Hour Submersion in Cold Water (%)	6.13	7.23	6.40	6.16	6.17	6.42	03/15/2012
5 Hour Submersion in Boiling Water (%)	10.96	11.91	11.14	10.94	11.00	11.19	
Saturation Coefficient (Ratio of 24H to 5H)	0.56	0.61	0.57	0.56	0.56	0.57	
<b>Efflorescence</b>	<b>11</b>	<b>12</b>	<b>13</b>	<b>14</b>	<b>15</b>		
	Not Effloresced		03/01/2012				

*The brick represented by the test results shown here comply with the standards listed below:*

ASTM C 1088 - 12 Standard Specification for thin Veneer brick Units Made From Clay or Shale  
Grade: Exterior, Interior



John Sanders, Ph.D., PE, Director

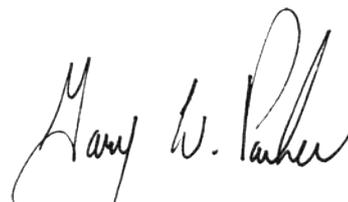

Gary W. Parker, Laboratory Supervisor